



NOTES:

1. MINIMUM CONCRETE STRENGTH TO BE 32 MPa AT 28 DAYS.
2. CONCRETE COVER OVER REINFORCEMENT TO BE 65mm MINIMUM.
3. CRADLE TO BE CONSTRUCTED PRIOR TO LAYING OF PIPE.
4. PILES ARE TO BE "JETTED" INTO SAND.
5. TRESTLES ARE TO BE LOCATED AT JOINT IN PIPES.

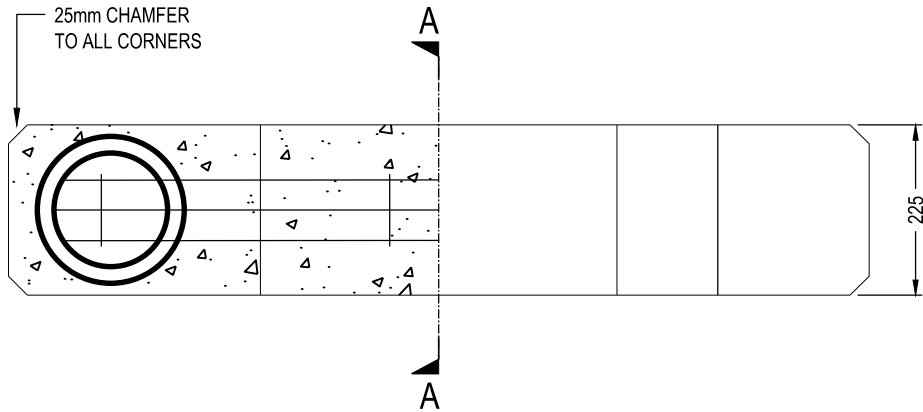

PLAN

SCALE 1:20

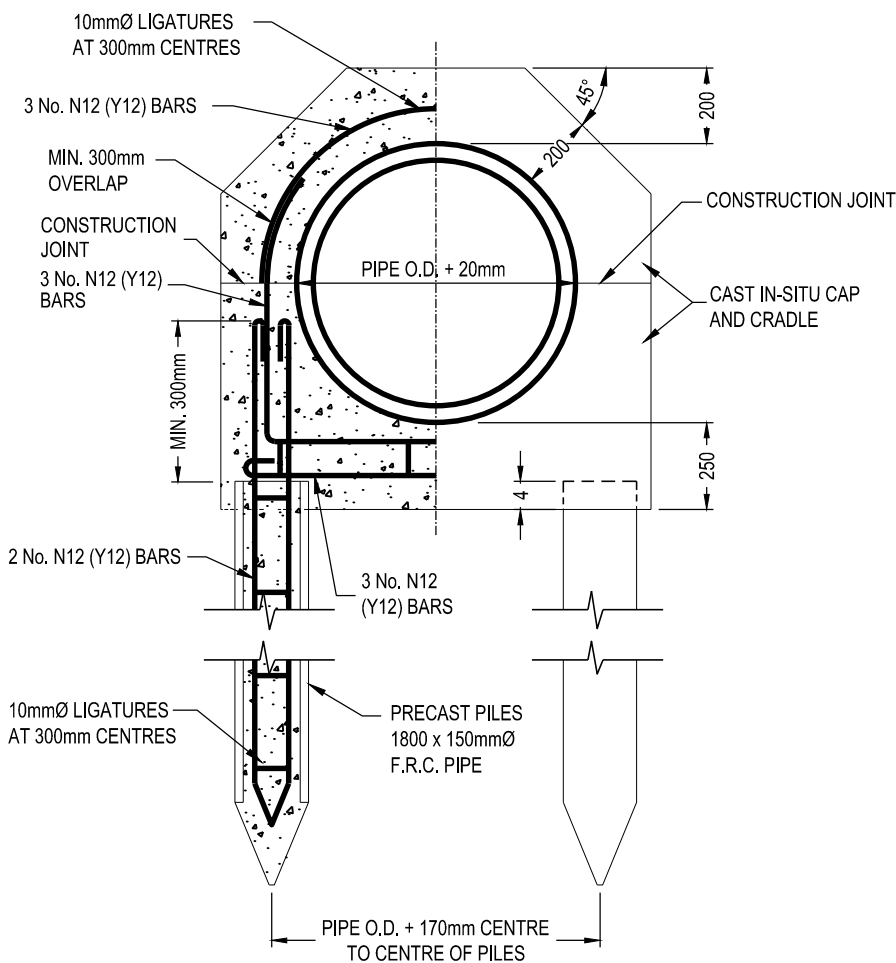

SECTION A-A

SCALE 1:20



MORNINGTON
PENINSULA
Shire

STANDARD PLAN
PIPE TRESTLE FOR SAND
LOCATION

[Signature]

MANAGER - INFRASTRUCTURE PROJECTS

DATE OF ISSUE
SHEET NO

10/01/2025
1 OF 1

MP502